



Notes:

1. Top of curb to be troweled and have a light brush finish.
Face of curb to be troweled and have a light brush finish.
Gutter to be rubber floated.
2. ¼" to ½" felt expansion joint to be placed at a maximum of 40 feet and additional deep score joints at a maximum of 20 feet.
3. All work shall conform to Section 73 and 90 Caltrans Standard Specifications latest edition.
4. Hunt Process curing compound shall be applied to fresh concrete by rolling, brushing, or spraying for curing.

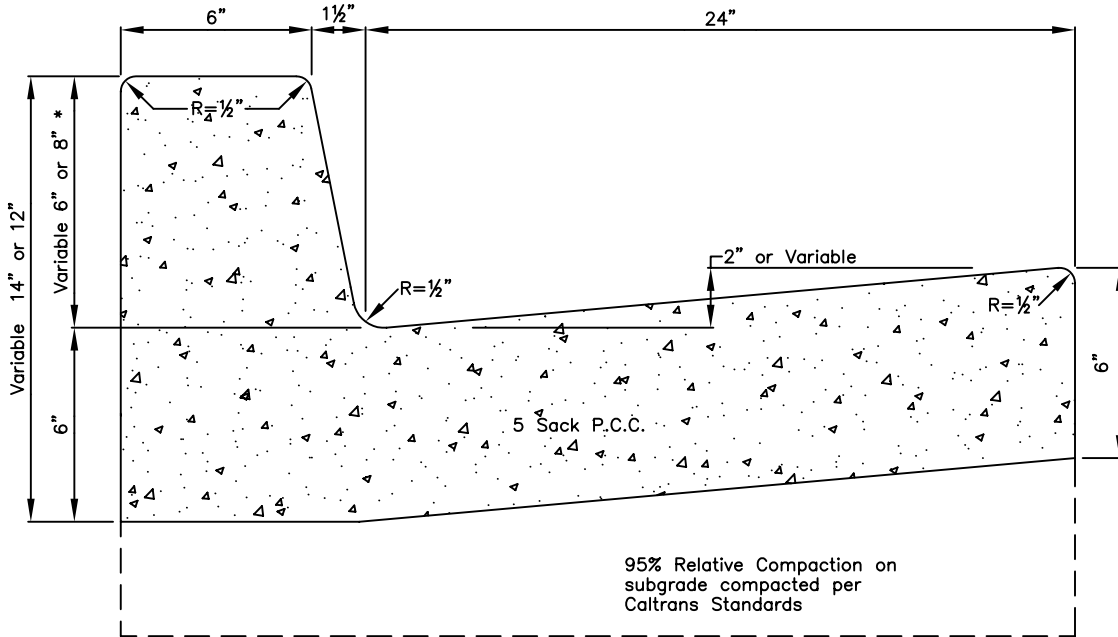

* 6" or 8" Curb will be determined by Road Commissioner consistent with location

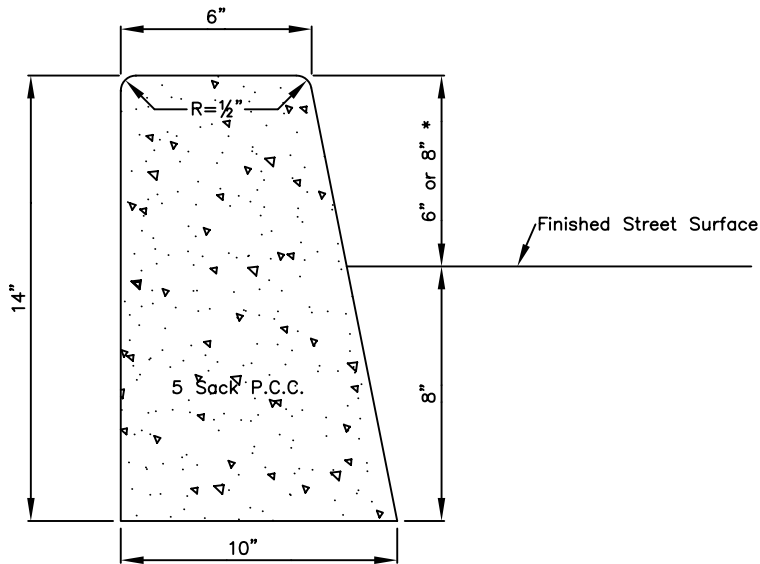

Spec's By _____

COUNTY OF MADERA

Date
3-5-80

Drawn By J. SHIELDS

TYPICAL CURB

Scale
NONE

APPROVED BY _____

**AND
CURB & GUTTER (CALTRANS)**

Drawing No.
ST-17

REVISIONS

8/1/02

10/1/02